


Attachment 3

iQ Terminal Block Connections -- TB1 through TB7

(Sheet 1 of 1)

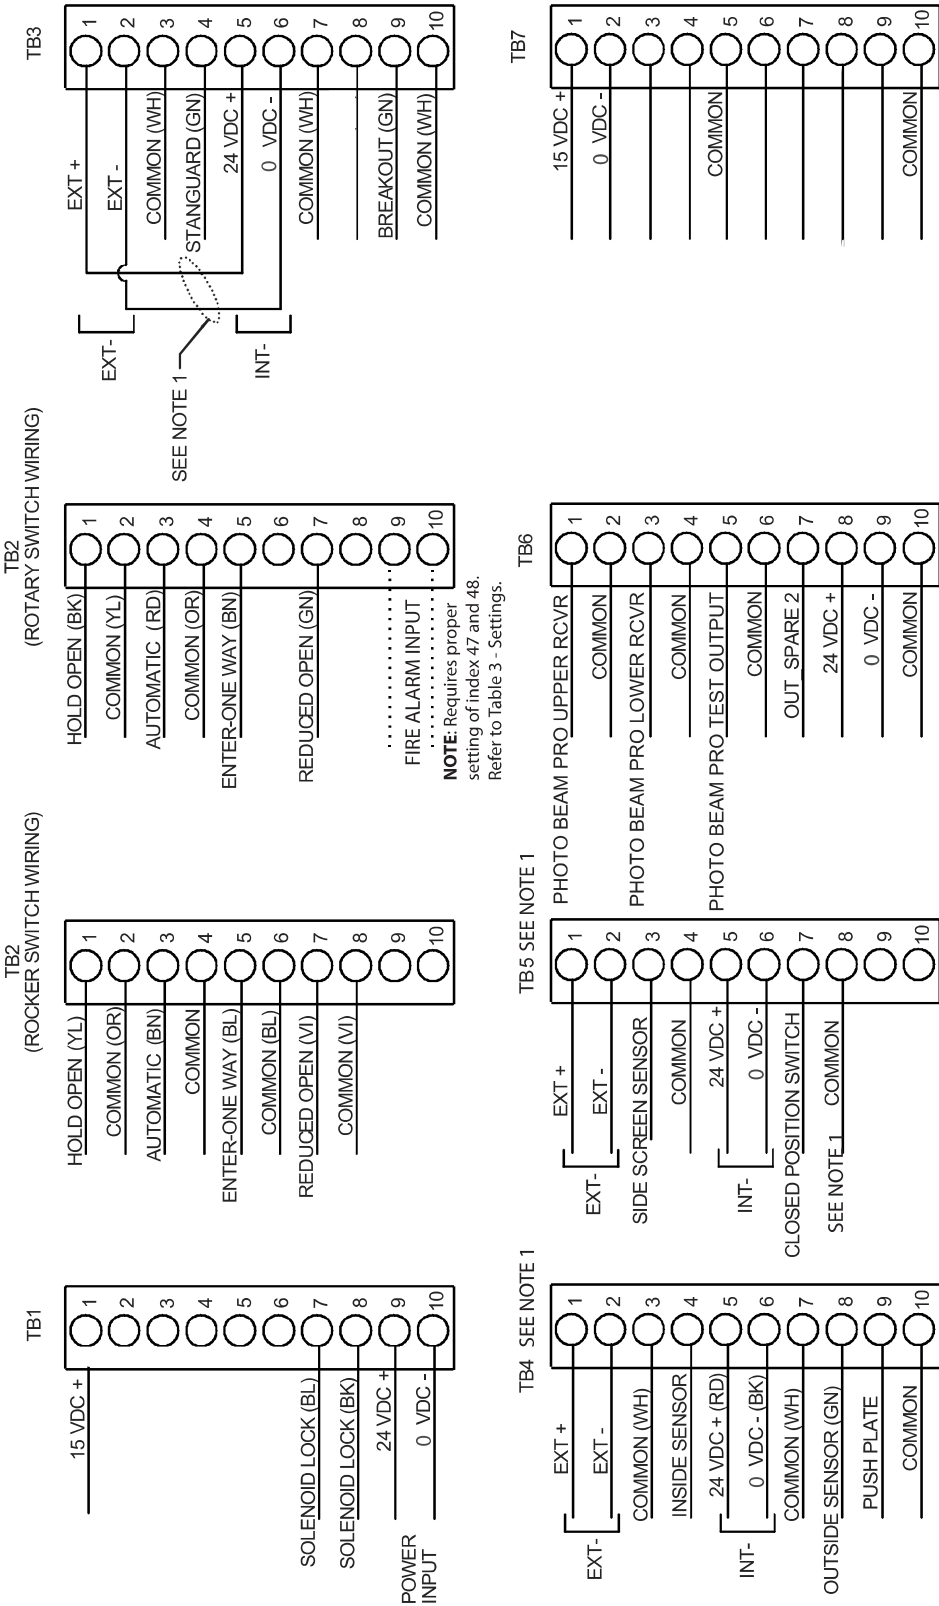

NOTE 1. REMOVE JUMPERS ON TB3 IF EXTERNAL POWER SUPPLY IS USED. JUMPERS ON TB3 CONNECT INTERNAL POWER SUPPLY (INT) TO THE EXTERNAL POWER SUPPLY BUS (EXT).